COMPOSE™/UNIGROUP TOO®

Extended Power Connector
Power Harness/Base to Beltline/Base to Standing
Installation Instructions

Tools Required


NOTE: Connection of panels to the permanent wiring of the building MUST be done by a licensed electrician, who must control the size, voltage drop and loading of each branch circuit. The person or group installing Haworth products is responsible for complying with all NEC and local code requirements.

WARNING: Power MUST BE DISCONNECTED before installation.


WARNING: Do not electrically interconnect circuits powered from two different feed modules. This poses a SHOCK HAZARD to service personnel and will cause a RISK OF FIRE due to excessive circulating currents.

NOTE: Raceways that are electrically interconnected must also be mechanically interconnected.

NOTE: Connectors are color coded as specified:

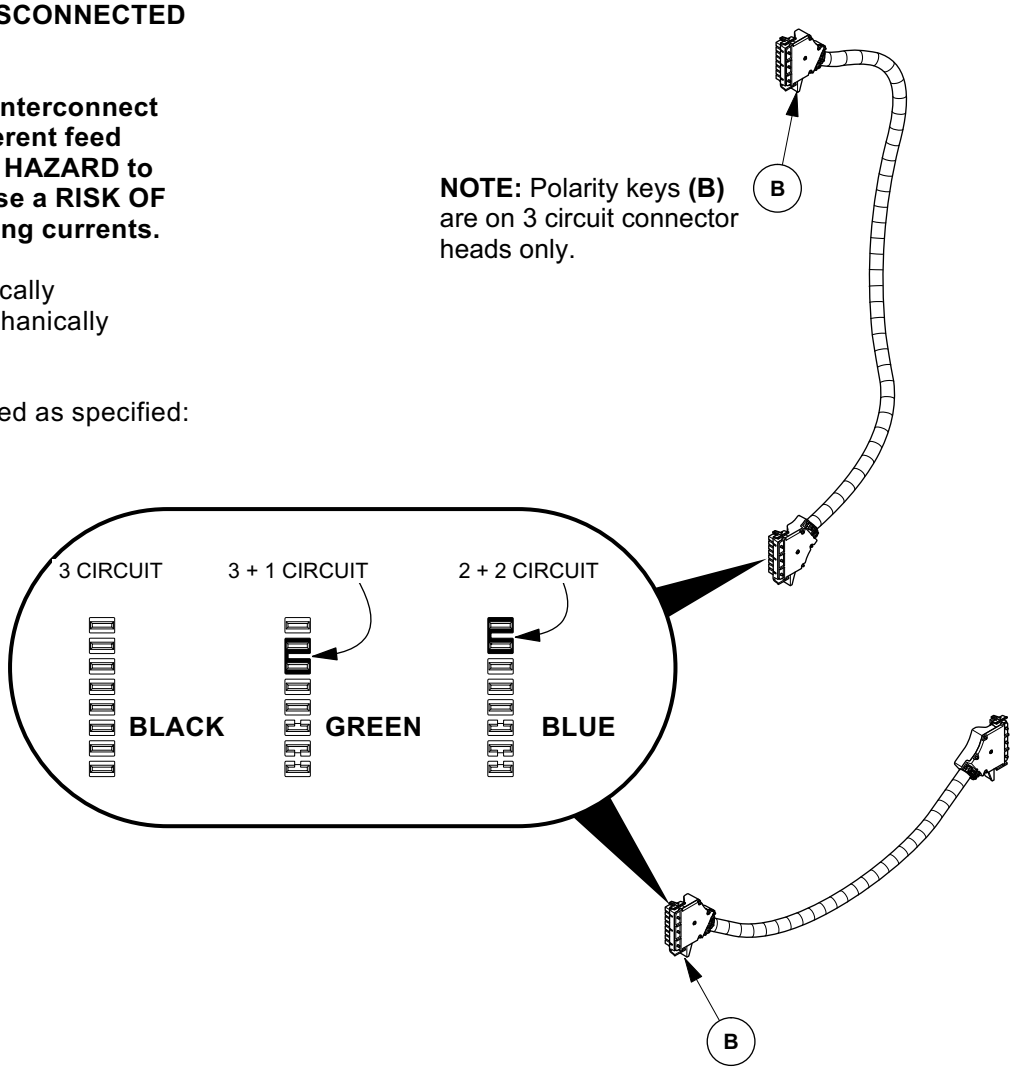


VERTICAL POWER HARNESS - Compose

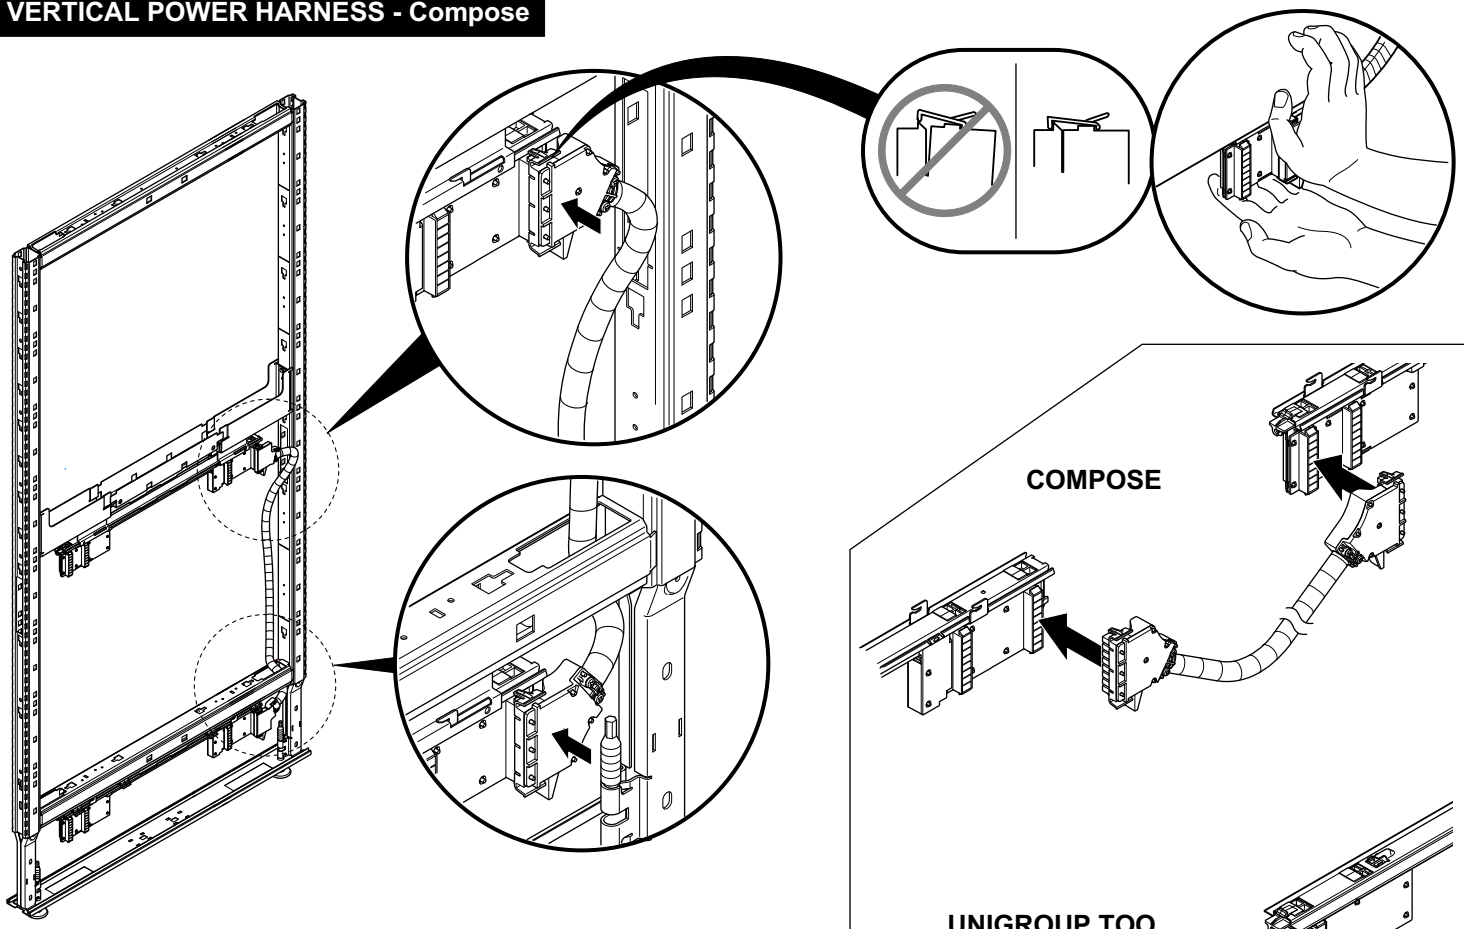



COMPOSE


UNIGROUP TOO

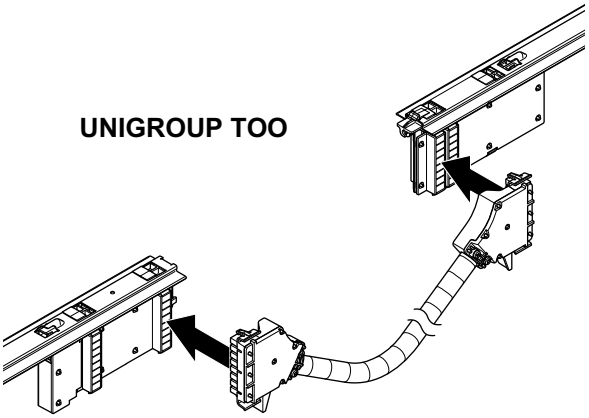


EXTENDED POWER CONNECTOR - Compose/UniGroup Too



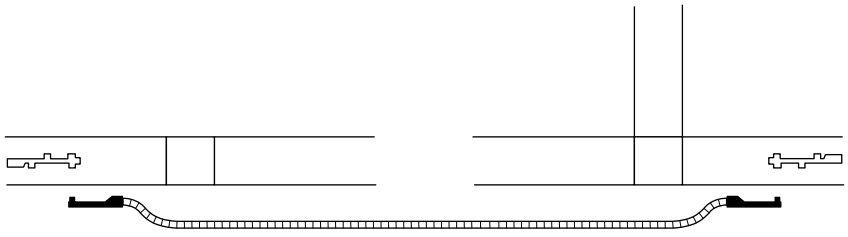

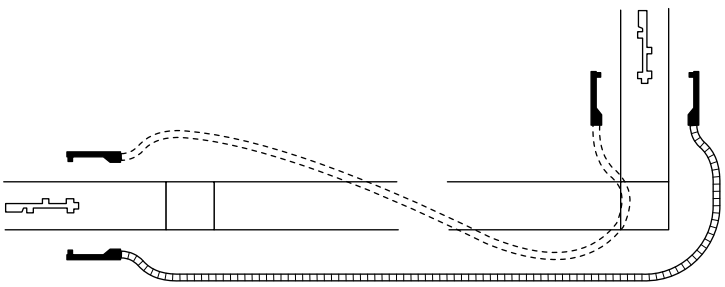

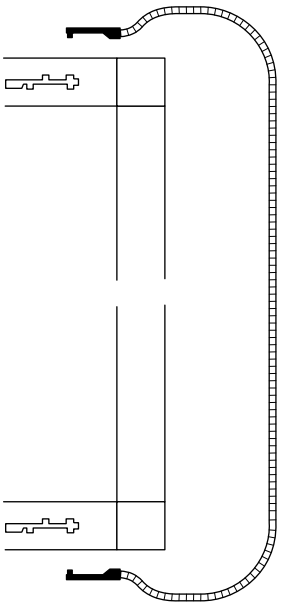

CUSTOMER SERVICE PHONE: 1-800-426-8562